

BRS

(Business Requirement Specification)

NORDIC

DETERMINE TRANSFER CAPACITY PROCESS

A market model for data exchange

Business process:	Nordic determine transfer capacity process
Version:	3.1.A
Status:	Approved by NMEG
Date:	September 27 th , 2024

Content

1	INTRODUCTION	3
1.1	BACKGROUND	3
1.2	NORDIC ENERGY DOMAIN MODEL.....	3
1.3	PROJECT ORGANISATION	3
1.4	REFERENCES.....	4
1.5	TERMS AND NOTATIONS	4
1.6	CHANGE LOG	5
2	PLANNING	6
2.1	PLANNING IN THE OVERALL CONTEXT (DOMAIN MODEL)	6
2.2	BREAKDOWN OF THE SCHEDULING PROCESS WITHIN THE PLANNING PHASE	7
2.3	OVERVIEW OF THE NORDIC DETERMINE TRANSFER CAPACITY PROCESS	9
3	BUSINESS PARTNER VIEW, DETERMINE TRANSFER CAPACITY	13
3.1	ROLES FROM THE EBIX®, EFET AND ENTSO-E HARMONISED ROLE MODEL, SEE [4]:	13
3.2	DOMAINS FROM THE EBIX®, EFET AND ENTSO-E HARMONISED ROLE MODEL, SEE [4]:	14
3.3	NORDIC DEFINED ROLES:	14
4	BUSINESS DOMAIN VIEW	15
4.1	BUSINESS AREA: DETERMINE TRANSFER CAPACITY	15
4.2	PROCESS AREA: PROPOSE TRANSFER CAPACITY	16
4.3	PROCESS AREA: NOTIFY TRANSFER CAPACITY.....	18
5	BUSINESS DATA VIEW	19
5.1	ECAN CAPACITY DOCUMENT IEC62325-451-2 Ed.2.....	19
5.1.1	<i>Class diagram: ECAN Capacity document contextual model.....</i>	<i>19</i>
5.1.2	<i>Class diagram: ECAN Capacity document assembly model.....</i>	<i>20</i>
5.1.3	<i>Attribute usage: ECAN Capacity document</i>	<i>21</i>
5.1.4	<i>Dependency matrix: ECAN Capacity document</i>	<i>24</i>
5.1.5	<i>Business rules for the transfer capacity document in the Nordic countries</i>	<i>25</i>

1 Introduction

1.1 Background

Today the Nordic TSOs exchange messages based on several different formats and standards, such as Ediel (DELFOR/MSCONS), NOIS XML messages based on ENTSO-E IGs and Excel documents. In addition the Nordic TSOs have communications towards other European countries, such as Germany, the Netherlands and Poland, using even more standards, such as NorNed xml and ENTSO-E standards.

For efficiency reasons the four Nordic TSOs have set up the NMEG (Nordic Market Expert Group) for migration of the document exchanges towards one common document standard, and later maintenance of the Nordic document exchanges. The aim is to define document exchange models that can be used for all document exchanges between the actors in the Nordic energy market, Nordic TSOs and Market Operators.

This document is a *Business Requirement Specification* (BRS) detailing the document exchanges related to *determination of transfer capacity* in the Nordic countries. The focus of the document is the business aspects of the document exchanges and the basis for the document is the ENTSO-E ECAN Implementation Guide [1], together with the ebIX[®], EFET and ENTSO-E Harmonised role model [4] and NBM capacity market documents. When implementing the BRS, the ENTSO-E ECAN Implementation guide and the related ENTSO-E XML schemas should be used.

1.3 About Nordic Ediel BRSs

The NMEG Ediel Business Requirement Specifications (BRSs) describes business processes where data is exchanged between market participants in the Nordic energy market based on the UN/CEFACT Modelling Methodology (UMM). A BRS is a tool that helps the participants in the Nordic energy market to implement effective and harmonised data-exchange processes. The Ediel BRSs can be seen as a framework designed to improve communication between stakeholders, reduce development time, and minimise errors.

The Nordic Ediel BRSs covers all aspects of a business requirement specification for a specific data-exchange process and purpose, including functional requirements, non-functional requirements (partly), UseCases, and data flows.

NMEG Ediel BRSs will as far as possible be based on already available standards and best practices, such as:

- 1) ENTSO-E Implementation Guides (IGs) based on IEC 62325-451-n standards
- 2) ENTSO-E Implementation Guides (IGs) based on IEC 62325-351 standard
- 3) Other Implementation Guides (IGs) based on IEC 62325-351 standard
- 4) EU Implementation Regulations
- 5) Documents from the DSO Entity and the ENTSO-E and DSO Entity Joint Working Group (JWG)
- 6) Nordic BRSs, IGs, regulations etc.

In addition, the NMEG Ediel BRS will document Nordic extensions and/or restrictions compared with the standards and best practices the BRS is based on.

1.2 Nordic Energy Domain Model

A Nordic Energy market Domain model, giving an overall overview of the structure and processes used in the Nordic Energy market, can be found in [6].

1.3 Project organisation

The document is written by NMEG (Nordic Market Expert Group), see www.ediel.org.

1.4 References

- [1] ENTSO-E implementation guides, see <http://entsoe.eu/index.php?id=73>
 - Implementation Guides
 - CIM XML schemas
 - MADES specifications
 - Etc.
- [2] [UN/CEFACT Unified Modelling Methodology \(UMM\)](#)
- [3] [UN/CEFACT XML Naming and Design Rules \(NDR\)](#)
- [4] [The Harmonised Role Model, ENTSO-E, eBIX® and EFET](#)
- [5] Ediel BRSs, see <http://www.ediel.org/>, such as BRS for Nordic Scheduling and Ancillary Services Processes
- [6] Ediel Common Nordic XML rules and recommendations, see <http://www.ediel.org/>
- [7] Nordic Energy Market Domain Model, see <http://www.ediel.org/>
- [8] NBM Implementation Guides, see <https://nordic-balancing.pages.fifty.eu/information/index.html>, especially:
 - [mFRR ATC AOF](#)
 - [mFRR ATC TSO](#)
 - [mFRR Remaining ATC AOF](#)

1.5 Terms and notations

The term *document* is used instead of *message* when this is applicable. However, when referencing ENTSO-E document names, the ENTSO-E name will be used, e.g., message, report, or document.

Documents are described by a class diagram showing the full set of attributes in the related xml schema. In addition, the usage of the document is described by one or more tables detailing the usage of each attribute. Optional attributes from the class diagram, not used in the specific data exchange, are omitted from the table. In addition the cardinalities, e.g., [0..1], may be stricter in the detailed descriptions than in the original ENTSO-E documents.

Some abbreviations used:

ACE OL	Area Control Error Open Loop
aFRR	Automatic frequency restoration reserve
AOF	Activation Optimisation Function
ATC:	<i>Available Transfer Capacity</i> (ATC) exchanged between <i>System operators</i> and between <i>System operators</i> and the <i>Transmission capacity allocator</i> . The ATC for a certain market cannot be changed after the closure of the relevant market. The ATC may be negative.
BRP	Balance Responsible Party
BRS	Business Requirement Specification
BSP	Balancing Service Provider
ECAN	ENTSO-E Capacity Allocation and Nomination
FRR	Frequency Restoration Reserve

mFRR	Manual Frequency Restoration Reserve
NBM	Nordic Balancing Model
NTC	Net Transfer Capacity
OC:	<i>Operational capacity</i> exchanged between <i>System operators</i> . The OC is the available transfer capacity as established during the operational day, i.e. the capacity available after closure of the Intraday market. The OC is used for system operation and not for market purposes. The OC may be both higher and lower than the ATC. The OC may be negative.
TRM	Transmission Reliability Margin
TSO	Transmission System Operator
TTC	Total Transfer Capacity

1.6 Change log

Ver/rel/rev	Changed by	Date	Changes
3.1.A	Ove Nesvik	20240927	<ul style="list-style-type: none"> • Addition of Reason classes in the attribute table for the ECAN Capacity document • Addition of a dependency table for ECAN Capacity document • Addition of dependencies for NBM Capacity Current NTC TSO.
3.0.A	Ove Nesvik	20230626	Version 3.0 is a complete recast of version 2.0, hence changes have not been tracked.

Table 1: Change log

2 Planning

2.1 Planning in the overall context (Domain model)

The *Domain model* describes the core business process areas needed to have a well-functioning energy market. The model is important for having a common and agreed understanding on how the energy market works as a basis for development of common methods for exchange of information.

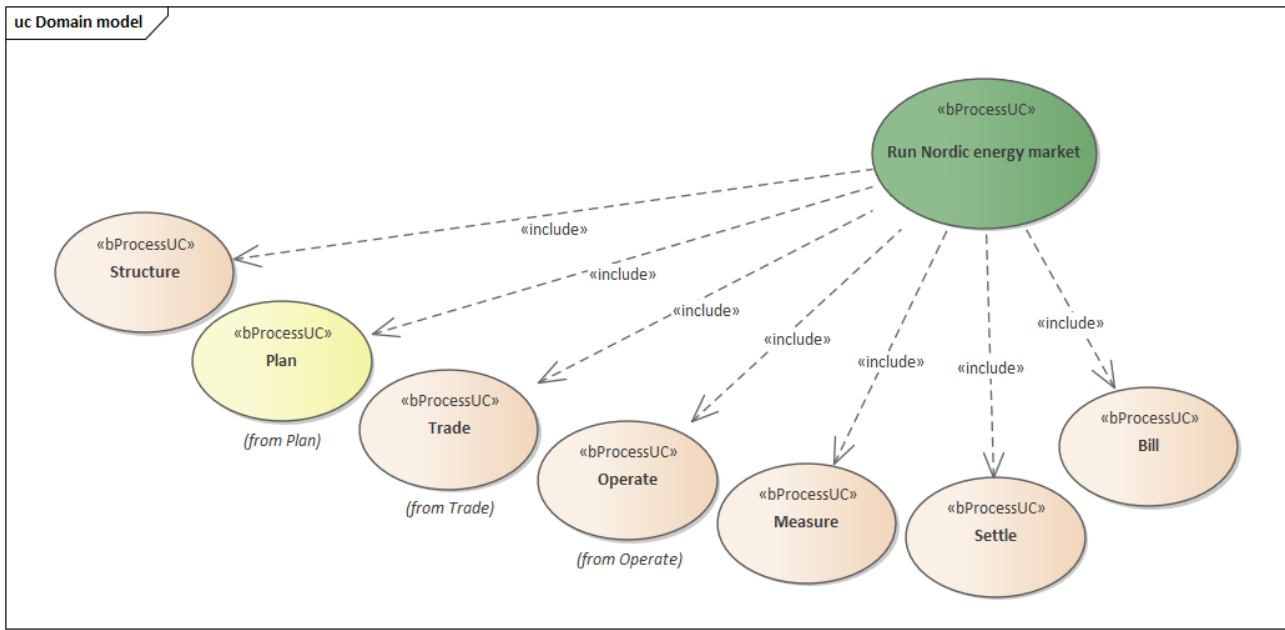


Figure 1: UseCase diagram Domain model

The domain model of the energy market covers all stages from the structuring of the market until the settlement and billing of consumption and transport of energy, with a focus on the exchange of information:

- **Structure:** Exchange of master data including the Change of Supplier processes
- **Plan:** Planning of production, consumption, exchange, and transport
- **Trade:** Trade on different markets, including ancillary services, bilateral trade, etc.
- **Operate:** Operation
- **Measure:** Measuring of production, consumption, exchange, and transport
- **Settle:** Settlement
- **Bill:** Billing

The Nordic determine transfer capacity process is a part of the process area Plan.

For a more elaborated description of the process include in the domain model, see [6].

2.2 Breakdown of the scheduling process within the planning phase

In the rest of this document the Business area (UseCase) Determine transfer capacity from the Business area Plan is further elaborated.

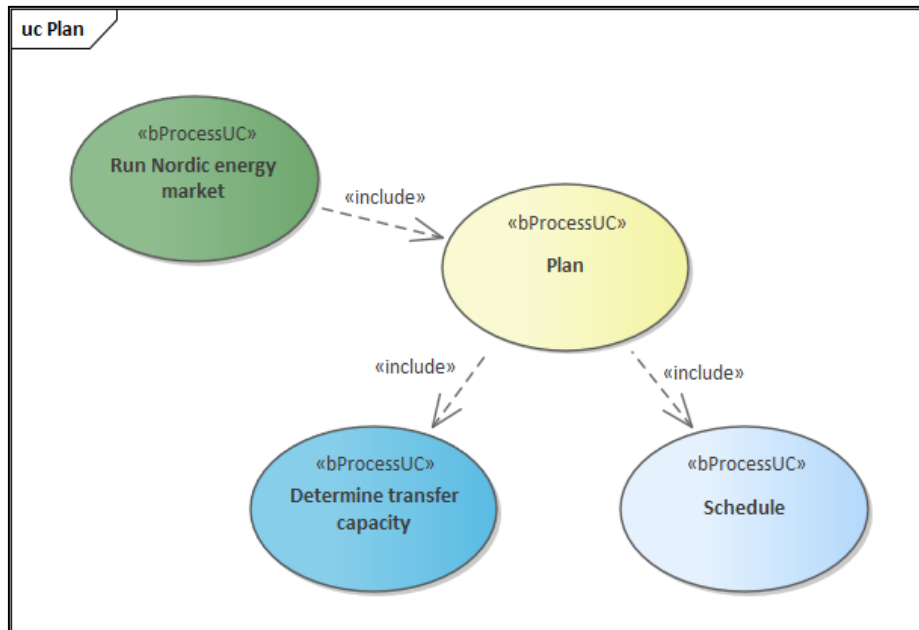


Figure 2: UseCase diagram: The Nordic planning process

The Schedule process is documented in a separate BRS, see [5].

The Process area Plan, outlined in **Figure 2**, concerns principally schedules and prognosis supplied by the different Balance Responsible Parties and the System Operator for a given Scheduling Area or a group of Scheduling Areas. It also deals with the exchange of schedules between two Scheduling Areas via System Operators and the Coordinated Capacity Calculator. Some of the resulting schedules are afterwards sent to the Imbalance Settlement Responsible after validation, to be used in the settlement process. Furthermore, the planning phase, include exchanges related to Reserve Resources.

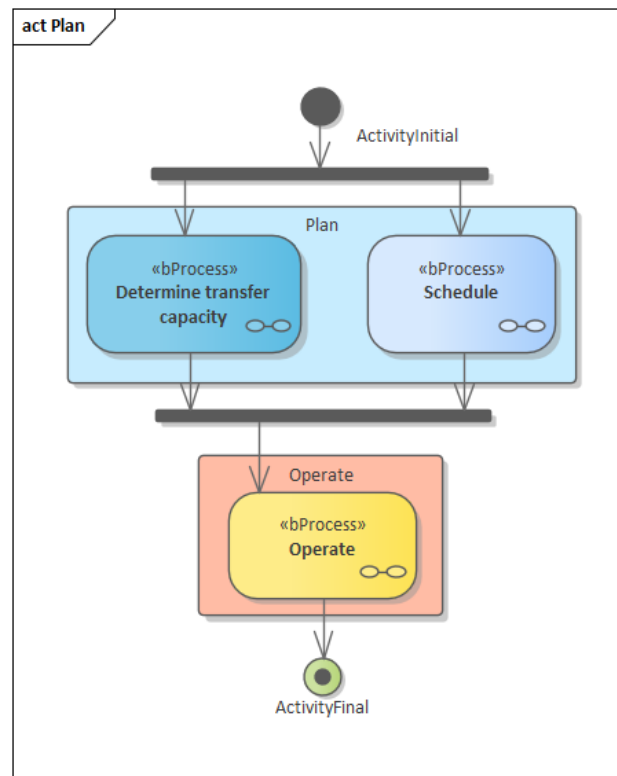


Figure 3: Activity diagram: The Nordic planning process

In the rest of this document the Business area Determine transfer capacity is further elaborated.

2.3 Overview of the Nordic determine transfer capacity process

There are some network grids within the ENTSO-E domain which are affected by structural congestion. Various congestion management methods such as, explicit auctioning, implicit auctioning, explicit auctioning involving two or more System Operators, etc. have been devised and implemented. The prerequisite for each of these methods is a transparent, non-discriminatory capacity allocation process in compliance with European regulations in particular [EC 2019/943](#).

Allocated transmission capacity, which can be on a long-term, daily or intraday basis, is validated during the final day ahead or intraday Scheduling process for cross border transactions.

This BRS is focussed on providing the generic information models for the data exchange between the Transmission Capacity Allocator, the System Operators and the Coordinated Capacity Calculator participating in the capacity market for cross border scheduling in the Nordic countries. The information models in question cover the essential requirements of all the congestion management methods identified above, however limited to those used in the Nordic market.

When determining the transfer capacities and margins between the Nordic countries the following three terms are used:

Total Transfer Capacity (TTC)

TTC is the maximum exchange program between two areas compatible with operational security standards applicable at each system if future network conditions, generation and load patterns were perfectly known in advance.

Transmission Reliability Margin (TRM)

TRM is a security margin that copes with uncertainties on the computed TTC values arising from:

- a) Unintended deviations of physical flows during operations due to physical functioning of load-frequency regulation,
- b) Emergency exchanges between *System Operators* to cope with unexpected, unbalanced situations in real time,
- c) Inaccuracies, e.g. in data collection and measurements.

In practice, only the definition a) described above is used in the Nordic countries.

The present TRM values for each connection are agreed upon in the System Operation Agreement.

Net Transfer Capacity (NTC)

The Net Transfer Capacity NTC (trading capacity) is defined as:

$$\text{NTC} = \text{TTC} - \text{TRM}$$

NTC is the maximum exchange program between two areas compatible with security standards applicable in both areas and taking into account the technical uncertainties on future network conditions.

The TTC between two subsystems is jointly determined by the TSOs on both sides of the interconnection.

When determining the capacity on the interconnection between two subsystems, the capacity is calculated by the System Operators on each side of the connection by using computer programs based on coordinated network models. If the values differ, the lowest value is used.

The objective is to give the market as high capacity for energy trade as possible taking into account outages and faults in the network.

The ability to transmit power shall be calculated for each state of operation. This applies both to transmissions within each subsystem and to exchanges between subsystems. Most frequently, this is achieved by means of a transmission corridor (connecting line) being defined, and static and dynamic simulations determine how much power can be transmitted in any direction through the corridor before thermal overloads, voltage collapse and/or instability arise following a dimensioning fault. In the corridor, an arbitrary number of lines on different levels of voltage can be included.

The TTC is the maximum transmission of active power, which is permitted in transmission corridors (connecting lines) between the subsystems or individual installations. If the transfer capacity is exceeded, measures must be taken. The transfer capacity is set, using a certain safety margin (stability, voltage etc), at the transmission levels, which will entail network collapse in the event of dimensioning faults.

The NTC values between all the subsystems are given to Market Operator for day-ahead trading in its entirety. The System Operators guarantee the NTC value given for day-ahead trading. The remaining cross-border transmission capacity available under actual operational conditions after the day-ahead notification of planned trading flow is offered to the intra-day market. Capacities are updated automatically when market trades between parties across borders are made. Market splitting separates the intraday market areas dynamically when congestion occurs.

On the HVDC-connections, the thermal capacity (TTC) is normally used as NTC value in both directions and there is no need for any margin (TRM).

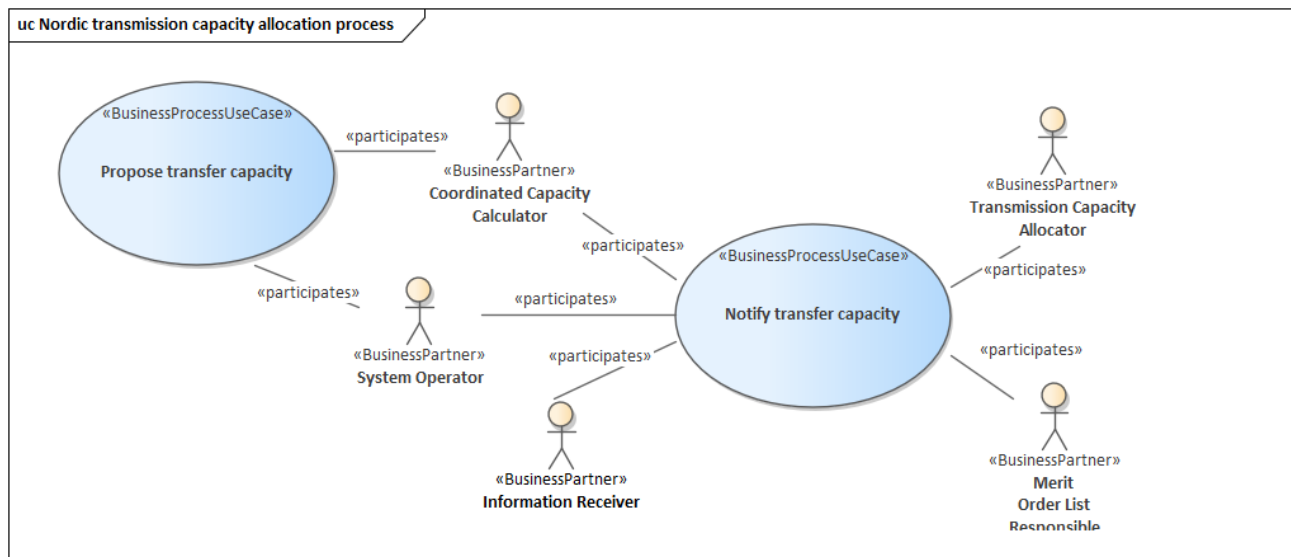


Figure 4 outlines the generic steps that are required in a capacity allocation process. This BRS defines the data interchanges that will be required to enable such a generic process to operate. The registration and qualification of market participants to enable them to participate in the market is outside the scope of this guide.

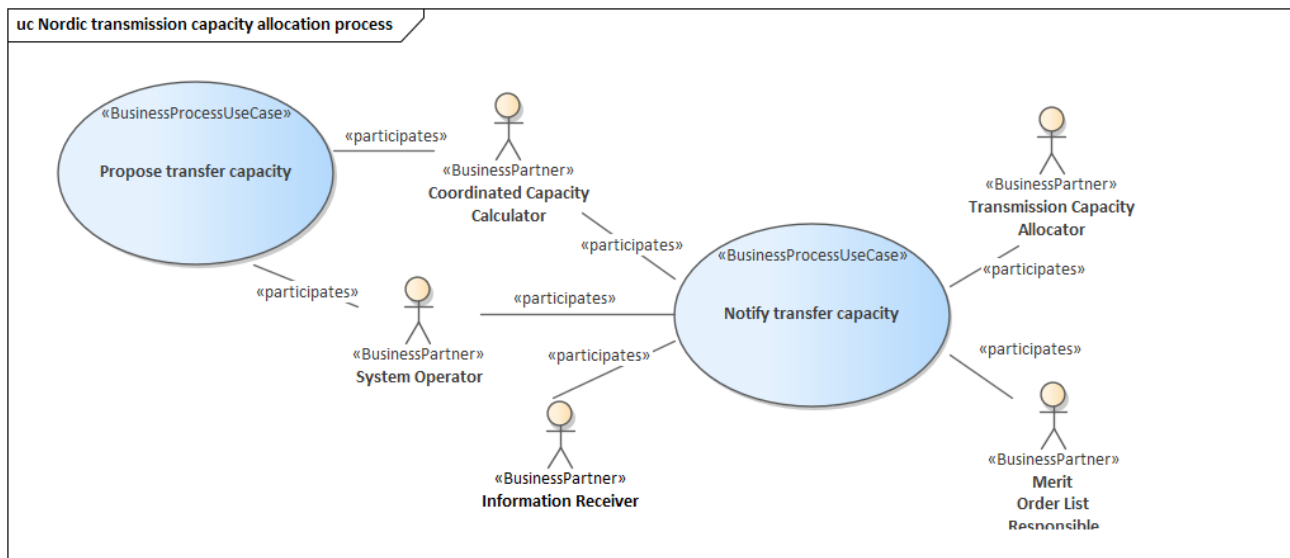


Figure 4: UseCase of the transmission capacity allocation process in the Nordic market¹

There are two principal activities in such a process. The first step relates to the identification of all available transmission capacity that can be allocated. The available capacity has initially to be agreed between the System Operators through the Coordinated Capacity Calculator. The main actors in the process are the System Operators, Coordinated Capacity Calculator and the Transmission Capacity Allocator.

The second step covers allocation activity itself and publication (distribution) of the available transmission capacity. Once agreed it is made available to the market participants through the Transmission Capacity Allocator.

This BRS defines the information flows required to satisfy these two steps and it is particularly focused on the day-ahead capacity allocation market for implicit auctioning.

¹ The Merit Order List (MOL) Responsible is used in this document because of TERRE processes - The MOL Responsible is having both the MOL Responsible role and the LFC Operator role.

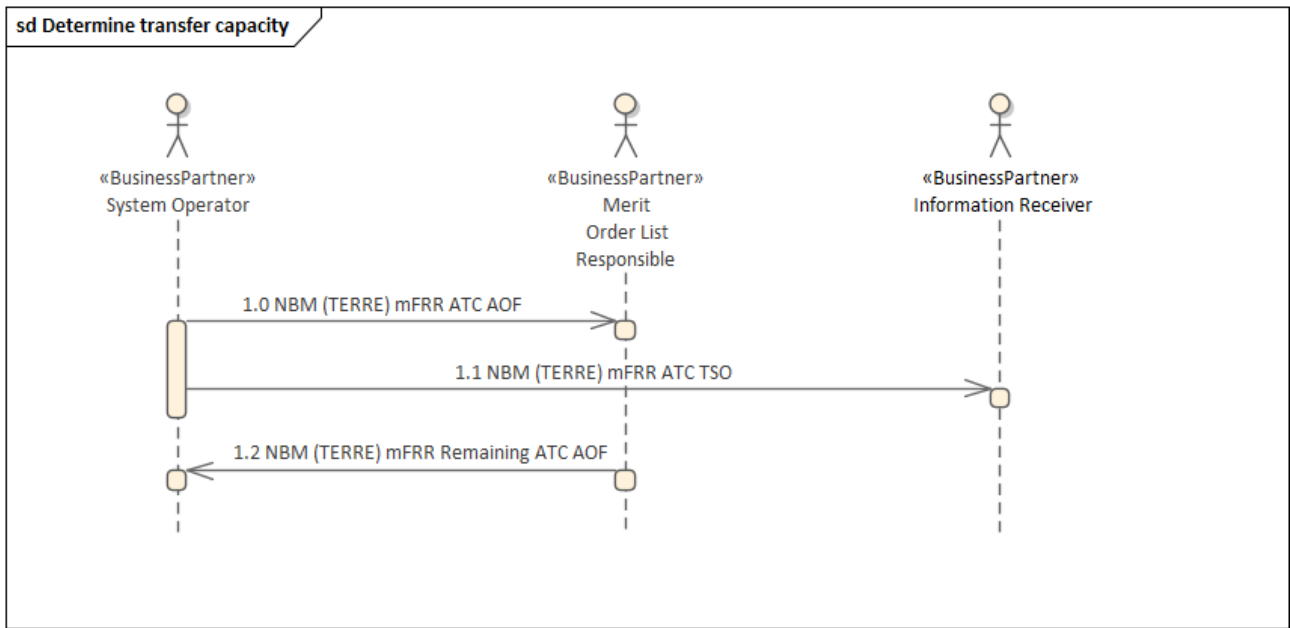


Figure 5: Sequence diagram: Information exchange overview for “determine transfer capacity”

Process area	Arrow	Content	Where to find detailed description
Determine transfer capacity	1.0	NBM (TERRE) mFRR ATC AOF	ECAN Capacity Document IEC62325-451-2 Ed.2, see 5.1
	1.1	NBM (TERRE) mFRR ATC TSO	ECAN Capacity Document IEC62325-451-2 Ed.2, see 5.1
	1.2	NBM (TERRE) mFRR Remaining ATC AOF	ECAN Capacity Document IEC62325-451-2 Ed.2, see 5.1

Table 2: ENTSO-E documents used in the determine transfer capacity process

Figure 5 shows the main electronic documents exchanged between the System Operators, MOL Responsible and the Information Receivers.

3 Business Partner View, Determine transfer capacity

In **figure 4** and definitions below, the relevant parts of the ebIX[®], EFET and ENTSO-E Harmonised role model are outlined.

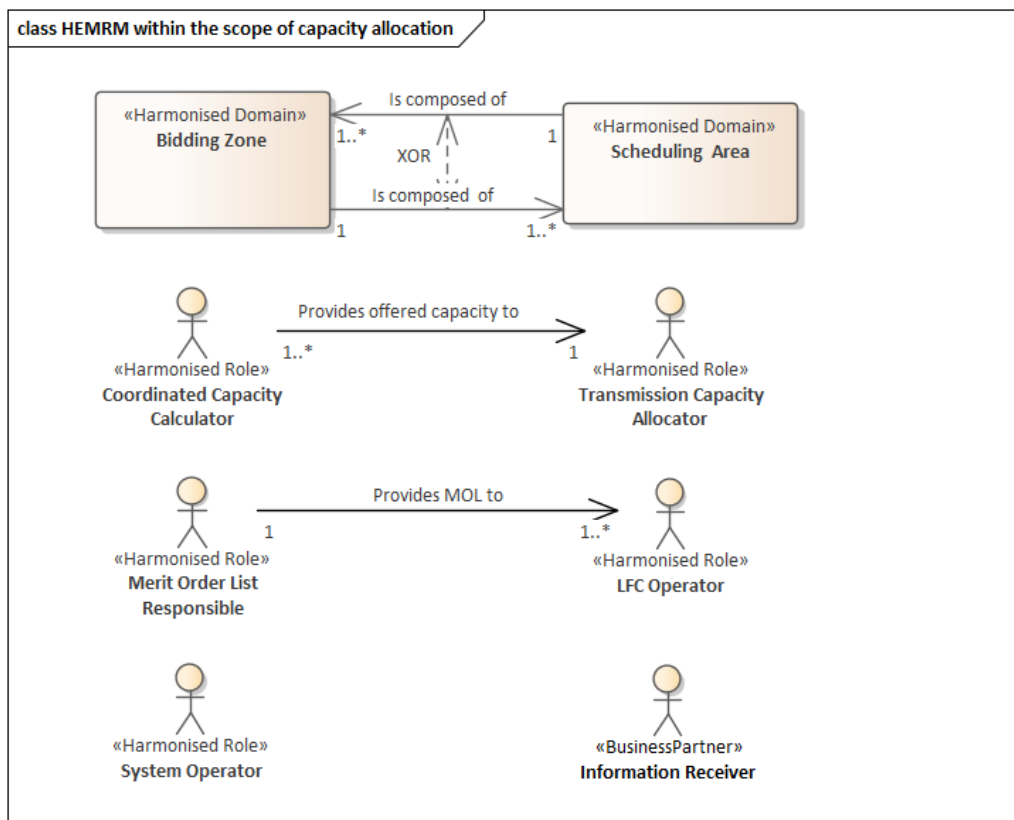


Figure 6: Outline of the Harmonised role model within the scope of capacity allocation

3.1 Roles from the ebIX[®], EFET and ENTSO-E Harmonised role model, see [4]:

Coordinated Capacity Calculator²: Coordinated Capacity Calculator is the entity or entities with the task of calculating transmission capacity, at regional level or above.

Source: [Commission Regulation \(EU\) 2015/1222 \(CACM\)](#).

LFC Operator Responsible for the load frequency control for its LFC Area or LFC Block.

Additional information:

This role is typically performed by a TSO.

Merit Order List Responsible Responsible for the management of the available tenders for all Acquiring LFC Operators to establish the order of the reserve capacity that can be activated.

System Operator: A party responsible for operating, ensuring the maintenance of and, if necessary, developing the system in a given area and, where

² NOIS will act in the role as Coordinated Capacity Calculator in the Determine transfer capacity process. NOIS is an information system for exchange of operational information between the Nordic System Operators.

applicable, its interconnections with other systems, and for ensuring the long-term ability of the system to meet reasonable demands for the distribution or transmission of electricity.

Additional information:

The definition is based on [DIRECTIVE 2009/72/EC OF THE EUROPEAN PARLIAMENT AND OF THE COUNCIL of 13 July 2009 concerning common rules for the internal market in electricity and repealing Directive 2003/54/EC, Article 2 \(Definitions\).](#)

Transmission Capacity Allocator³:

The Transmission Capacity Allocator manages, on behalf of the System Operators, the allocation of available transmission capacity for a Bidding Zone Border. He offers the available transmission capacity to the market, allocates the available transmission capacity to individual Capacity Traders and calculates the billing amount of already allocated capacities to the Capacity Traders.

Additional information:

The single allocation platform established by all TSOs for Forward Capacity Allocation performs the role of a Transmission Capacity Allocator.

3.2 Domains from the ebIX®, EFET and ENTSO-E Harmonised role model, see [4]:

Bidding Zone

The largest geographical area within which market participants are able to exchange energy without capacity allocation.

Source: [Commission Regulation \(EU\) 543/2013.](#)

Scheduling Areas

An area within which the TSOs' obligations regarding scheduling apply due to operational or organisational needs.

This area consists of one or more Metering Grid Areas with common market rules for which the settlement responsible party carries out an imbalance settlement and which has the same price for imbalance.

Source: [System Operation Guideline, Commission Regulation \(EU\) 2017/1485.](#)

Additional information:

This covers both Imbalance Area and Imbalance Price Area from the [Electricity Balancing Guideline \(2017/2195\).](#)

3.3 Nordic defined roles:

Information Receiver

A party, not necessarily a market participant, which receives information about the market.

³ The Market Operator will act in the role as Transmission Capacity Allocator in the Determine transfer capacity process in the Nordic countries.

4 Business Domain View

4.1 Business area: Determine Transfer Capacity

In the Nordic countries the congestion management is handled through implicit auctioning, involving the *System Operators*. The prerequisite is a transparent, non-discriminatory capacity allocation process in compliance with European regulations in particular [EC 2019/943](#). Allocated transmission capacity, which in the Nordic countries are on a daily (day-ahead) and hourly (Intraday) basis, is validated during the scheduling process for cross border transactions. In addition *Operational capacity* may be exchanged in the future as an intraday process.

This Business Requirement Specification (BRS) is focused on providing the generic information models for the data exchange between the *System Operators* and the *Transmission Capacity Allocator*. Needed communication towards the various market players participating in the capacity market for cross border scheduling may be covered on a later stage.

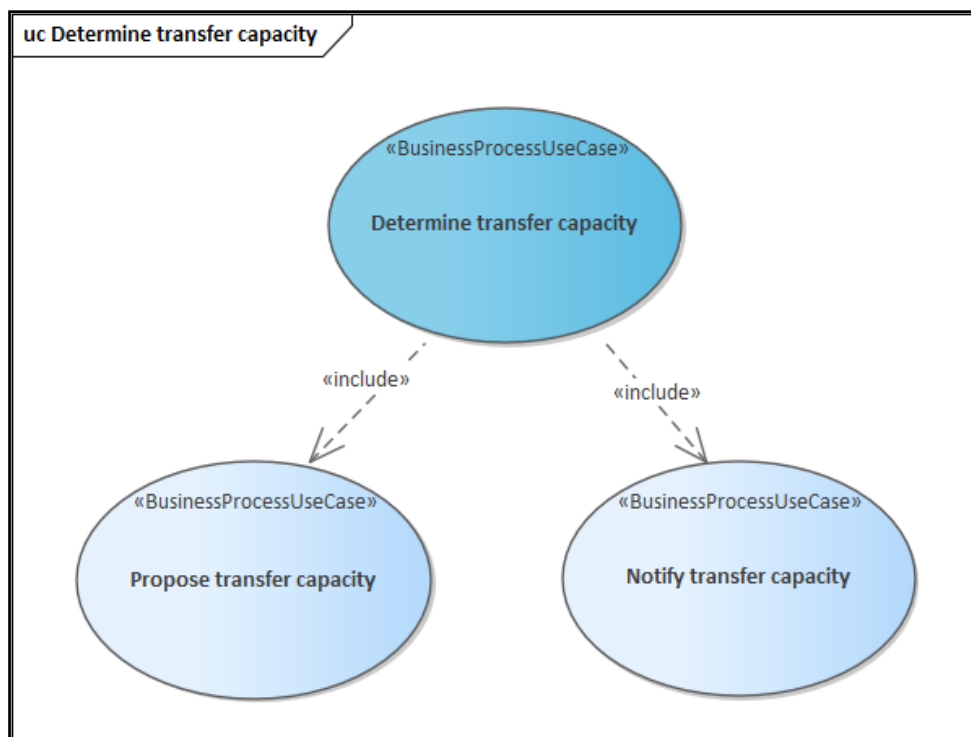


Figure 7: UseCase: Determine transfer capacity

Figure 7 outlines the steps that are required in a capacity allocation process in the Nordic countries. This BRS defines the data interchanges that will be required to enable such a generic process to operate.

In the Nordic countries the first step is identification of all Available Transmission Capacity (ATC) that can be allocated. The available capacity has to be agreed between the System Operators through the UseCase Propose transfer capacity. Once agreed it is made available to the market participants through the Transmission Capacity Allocator, i.e. UseCase Notify transfer capacity. The main actors in the process are the System Operators and the Transmission Capacity Allocator.

In the future (today only relevant for the NorNed cable) it may be possible for System Operators to adjust the ATC during the intra-day phase, i.e. determine the Operational Capacity (OC), also this according to the UseCase Propose transfer capacity.

This BRS defines the information flows required to satisfy these steps.

The Roles that take part in the Determine Transfer Capacity calculation are:

- System Operators (TSO) who perform all network security calculations and has the overall responsibility for the definition of Available Capacity between Bidding Zones.
- Coordinated Capacity Calculator who is an information system for exchange of operational information between the System operators.
- Transmission Capacity Allocator who provides data on the Already Allocated Capacity (AAC).

For Available Transfer Capacity (ATC) the System Operators agree the capacity that is to be offered to the market through the Coordinated Capacity Calculator and this agreed capacity is transmitted to the affected System Operators and the Transmission Capacity Allocator, who makes the information available to the market. The process is further described in the next chapters.

For Operational Capacity (OC) the System operators agree the capacity on an intra-day basis.

The Business area Determine Transfer Capacity can be split into to two processes; Propose transfer capacity and Notify transfer capacity:

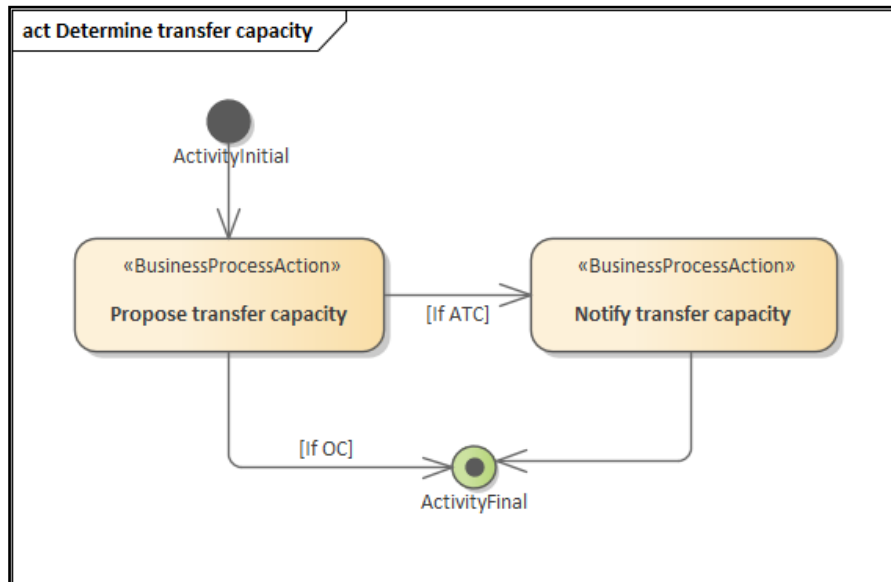


Figure 8: Activity diagram: Determine transfer capacity

4.2 Process area: Propose transfer capacity

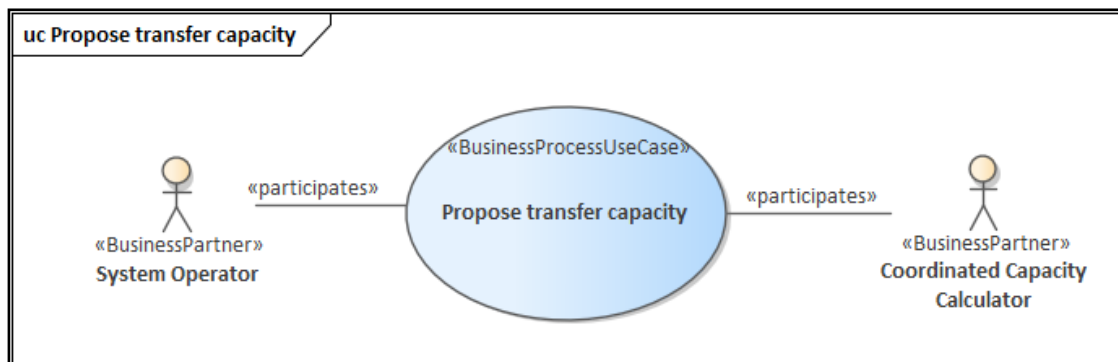


Figure 9: UseCase: Propose transfer capacity

When available and operational transfer capacities are agreed for exchange between the Nordic countries the roles that take part in the process are the System Operators and the Coordinated Capacity Calculator. When the capacities are agreed between a Nordic country and a non-Nordic country the approval process can be run as a bilateral process between a Leading System Operator and a Following System Operator, such as for the NorNed cable. In the rest of this BRS it is assumed that the process is run between Nordic countries.

Between a System operator and the Coordinated Capacity Calculator, plans for TTC are exchanged in order to determine Transfer Capacity for the operation of the cross-border connection. As a result of this process ATC is established by the Coordinated Capacity Calculator and thereafter notified to affected parties. It is used to plan operation of the cross-border connection.

The process may be run as TTC, the day before operation or as OC during intra-day.

A System Operator sends a proposal for transfer capacity, either TTC or OC, to the Coordinated Capacity Calculator.

Time constraints:

- TTC: In due time before the market needs the information.
- OC: When needed, also during the operational day.

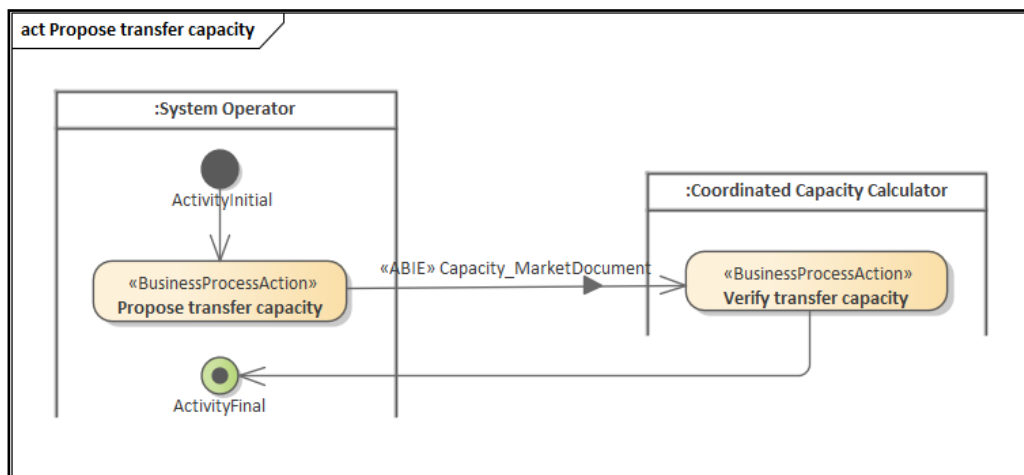


Figure 10: Activity diagram: Propose transfer capacity

4.3 Process area: Notify transfer capacity

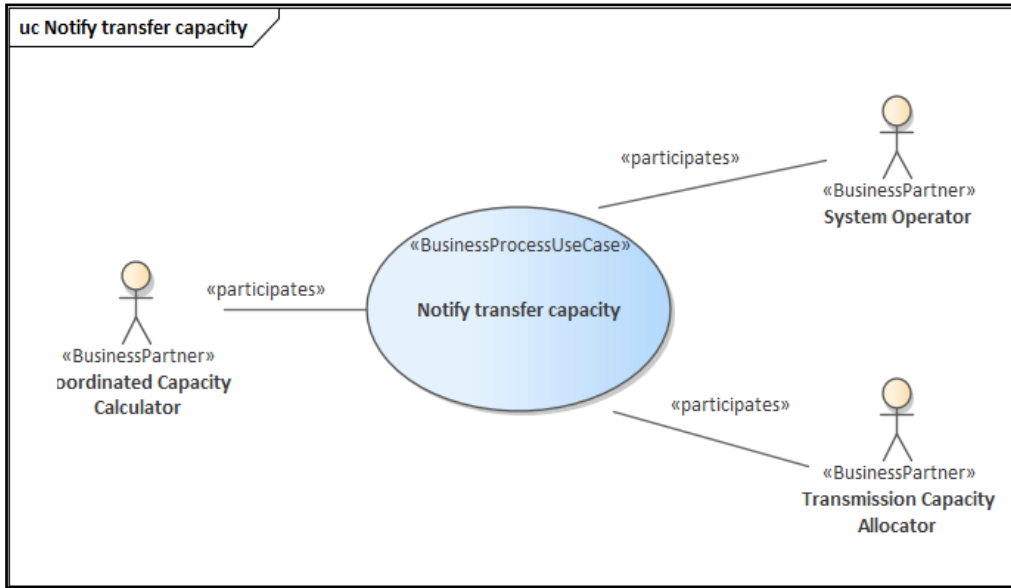


Figure 11: UseCase: Notify transfer capacity

After agreement of ATC the Coordinated Capacity Calculator notifies the offered capacity to the Transmission Capacity Allocator, who makes the information available to the market. In addition the Coordinated Capacity Calculator notifies affected System Operators. The notification process is run the day before operation for day-ahead, and both the day before and during the operational day for intraday.

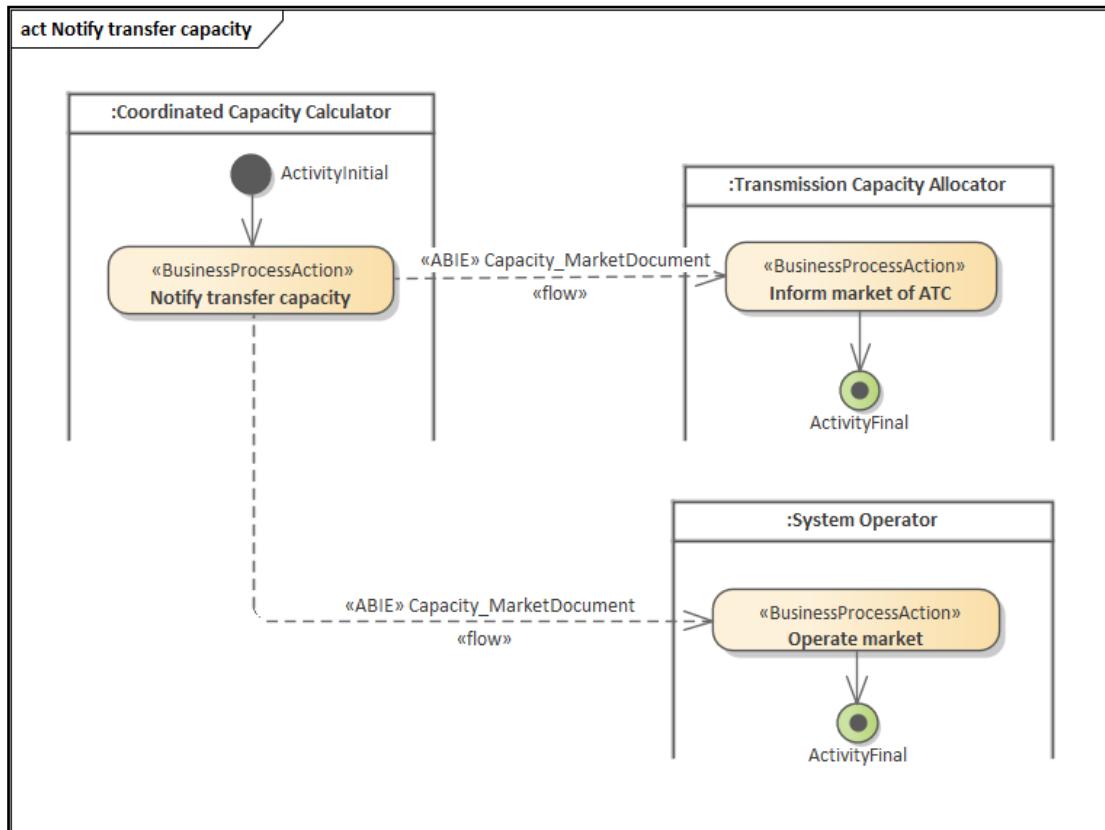


Figure 12: Activity diagram: Notify transfer capacity

5 Business Data View

5.1 ECAN Capacity Document IEC62325-451-2 Ed.2

The ECAN (ENTSO-E Capacity Allocation and Nomination process) Capacity Document is among others used for mFRR ATC exchanges.

This chapter describes a Nordic subset of the document described in IEC 62325 framework for energy market communications, Part 451, edition 2.

5.1.1 Class diagram: ECAN Capacity document contextual model

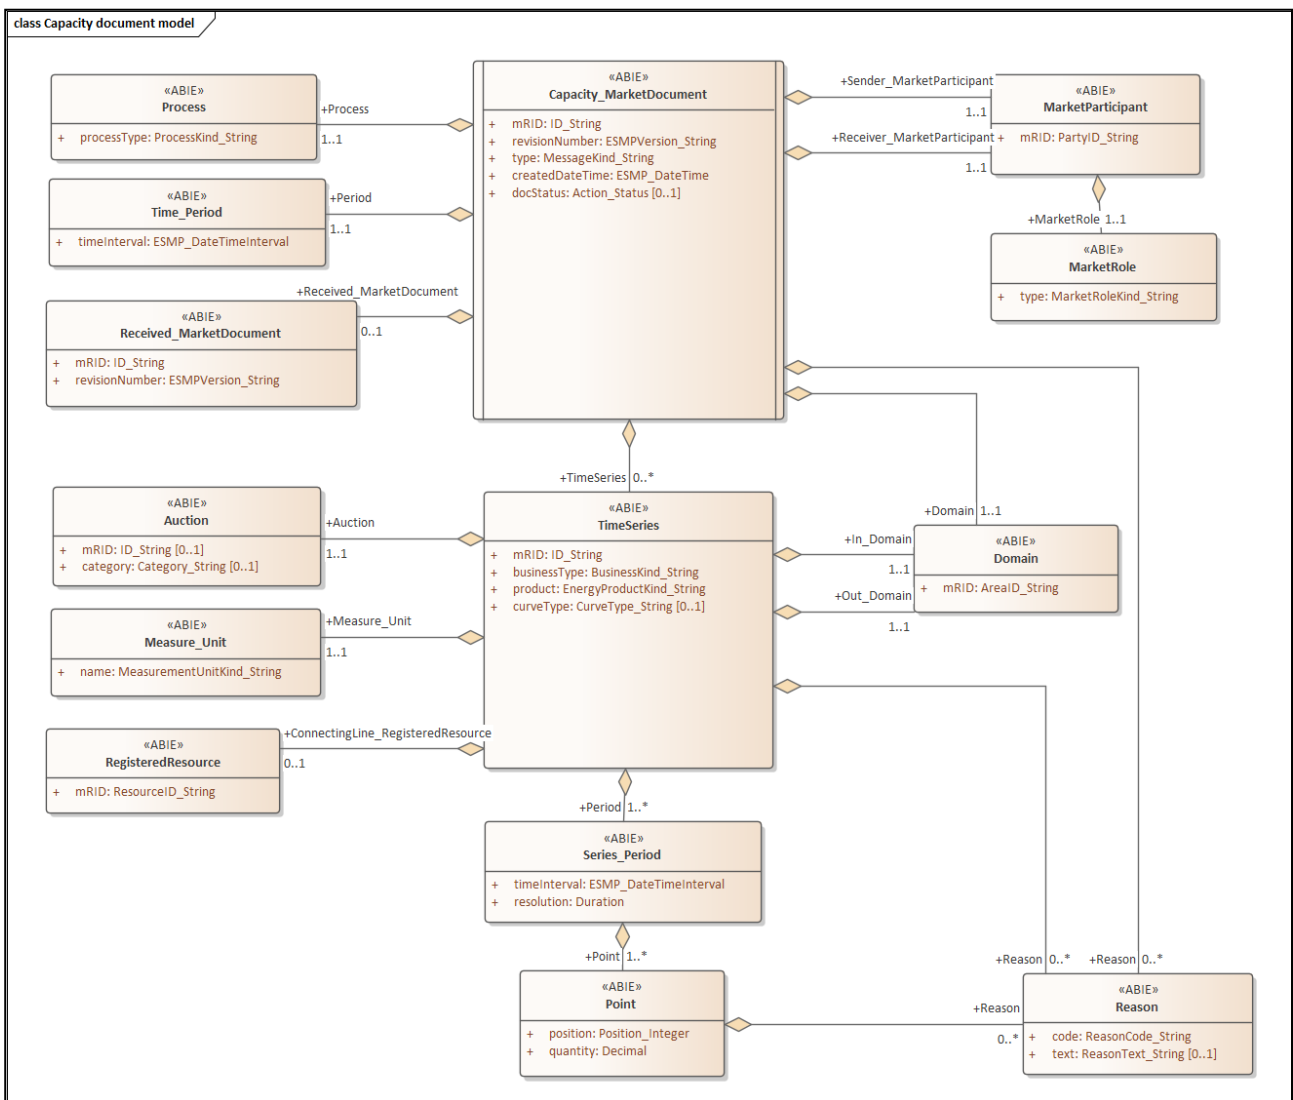


Figure 13: Class diagram ECAN Capacity document contextual model

5.1.2 Class diagram: ECAN Capacity document assembly model

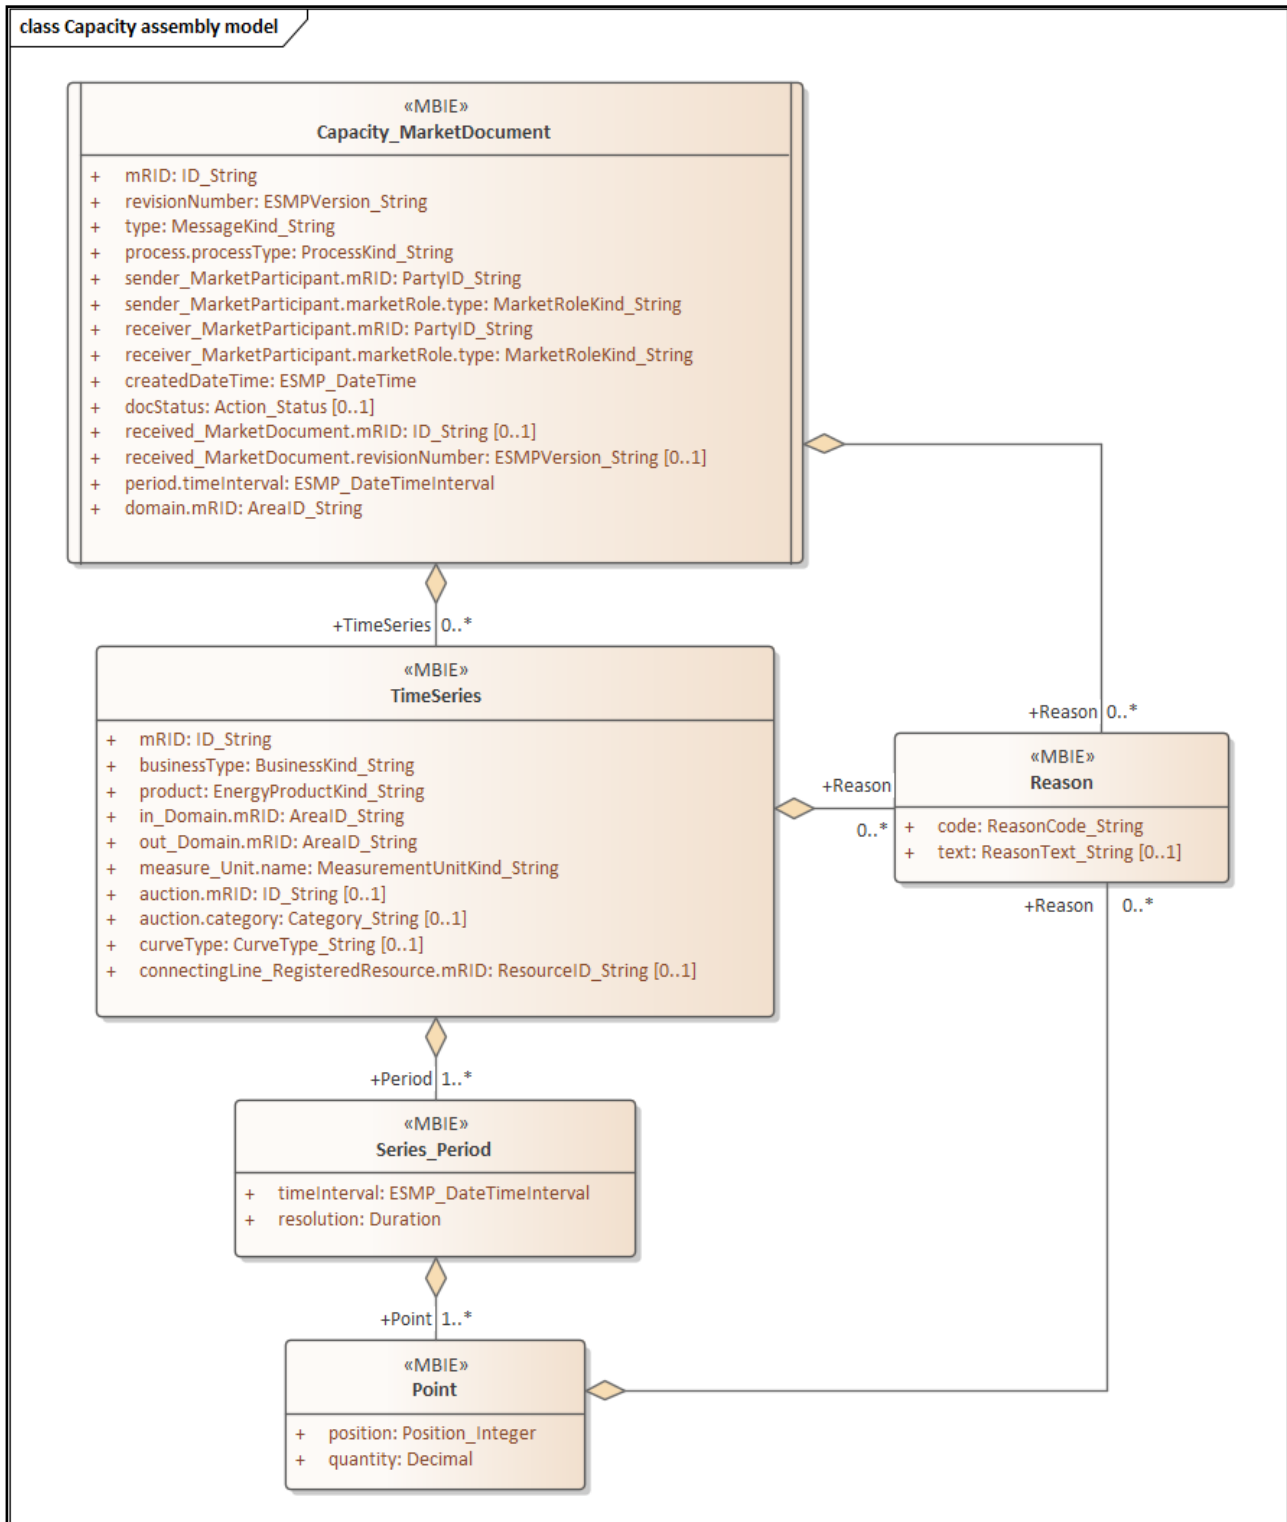


Figure 14: Class diagram: ECAN Capacity document assembly model

5.1.3 Attribute usage: ECAN Capacity document

IEC CIM Attribute	Cl.	Code and description
Capacity_MarketDocument	[1]	
mRID	[1]	The unique identification of the document being exchanged within a business process flow. Global uniqueness is easily achieved by using a UUID for the mRID. It is strongly recommended to do this.
revisionNumber	[1]	The identification of the version that distinguishes one evolution of a document from another.
type	[1]	A31 Agreed capacity A26 Capacity document
process.processType	[1]	A15 Capacity determination
sender_MarketParticipant. mRID	[1]	Identification of the party who is sending the document.
sender_MarketParticipant. marketRole.type	[1]	A04 System operator A35 MOL responsible
receiver_MarketParticipant. mRID	[1]	Identification of the party who is receiving the schedules.
receiver_MarketParticipant. marketRole.type	[1]	A04 System operator A33 Information Receiver A35 MOL responsible
createdDateTime	[1]	Date and time of the creation of the document.
docStatus	[0..1]	The identification of the condition or position of the document with regard to its standing. A01 Intermediate A02 Final A03 Deactivated A04 Reactivated
received_MarketDocument.mRID	[0..1]	The unique identification of the document being exchanged within a business process flow. --- The identification of the received document. The identification of an electronic document that is related to an electronic document header.
received_MarketDocument. revisionNumber	[0..1]	The identification of the version that distinguishes one evolution of a document from another. --- The identification of the received document. The identification of an electronic document that is related to an electronic document header.
period.timeInterval	[0..1]	The beginning and ending date and time of the period covered by the document.
domain.mRID	[1]	The EIC identification of the domain covered within the Capacity_MarketDocument: 10Y1001A1001A796 (Denmark) 10YFI-1-----U (Finland) 10YNO-0-----C (Norway) 10YSE-1-----K (Sweden)

IEC CIM Attribute	CI.	Code and description
Reason (header level)	[0..*]	
code	[1]	The motivation of an act in coded form.
text	[0..1]	The textual explanation corresponding to the reason code.
TimeSeries	[1..*]	
mRID	[1]	A unique identification of the time series.
businessType	[1]	A26 ATC
product	[1]	8716867000016 Active power
in_Domain.mRID	[1]	The area where the energy is to be put.
out_Domain.mRID	[1]	The area where the energy is coming from.
measurement_Unit.name	[1]	The identification of the formal code for a measurement unit (UN/ECE Recommendation 20). The unit of measure that is applied to the quantities in which the time series is expressed, e.g. MAW. MAW MW (Mega Watt)
auction.mRID	[0..1]	The unique identification of the auction. The identification of a set of specifications created by the auction operator.
auction.category	[0..1]	The identification of a set of specifications created by the auction operator. A01 Base A02 Peak A03 Off peak A04 Hourly
curveType	[1]	A01 Sequential fixed size block A03 Variable sized block A05 Non-overlapping breakpoint
connectingLine_Registered Resource.mRID	[0..1]	The identification of a resource associated with a TimeSeries. The identification of a set of lines that connect two areas; the transmission capacity rights are related to this set of lines.
	[1..*]	Series_Period
timeInterval	[1]	The start and end time of the period.

IEC CIM Attribute	CI.	Code and description
resolution	[1]	<p>The resolution defining the number of periods that the time interval is divided. The resolution is expressed in compliance with ISO 8601 in the following format:</p> <p style="text-align: center;">PnYnMnDTnHnMnS.</p> <p>Where nY expresses a number of years, nM a number of months, nD a number of days. The letter "T" separates the date expression from the time expression and after it nH identifies a number of hours, nM a number of minutes and nS a number of seconds.</p> <p>PT60M PT30M PT15M PT1M</p>
Point	[1..*]	
position	[1]	A sequential value representing the relative position within a given time interval.
quantity	[1]	The principal quantity identified for a point.
Reason (Point level)	[0..*]	
code	[1]	The motivation of an act in coded form.
text	[0..1]	The textual explanation corresponding to the reason code.
Reason (Time Series level)	[0..*]	
code	[1]	The motivation of an act in coded form.
text	[0..1]	The textual explanation corresponding to the reason code.

Table 3: Attribute usage of ECAN Capacity document assembly model

5.1.4 Dependency matrix: ECAN Capacity document

IEC CIM Attribute	NBM Capacity Current NTC TSO	NBM mFRR ATC AOF	NBM mFRR ATC TSO	NBM mFRR Remaining ATC AOF
Capacity_MarketDocument				
type	A31 Agreed capacity	A31 Agreed capacity	A31 Agreed capacity	A26 Capacity document
process.processType	A15 Capacity determination	A15 Capacity determination	A15 Capacity determination	A15 Capacity determination
sender_MarketParticipant. marketRole.type	A04 System operator	A04 System operator	A04 System operator	A35 MOL responsible
receiver_MarketParticipant. marketRole.type	A33 Information Receiver	A33 Information Receiver	A33 Information Receiver	A04 System operator
docStatus	A01 Intermediate A02 Final A03 Deactivated A04 Reactivated			
TimeSeries				
businessType	A27 NTC	A26 ATC	A26 ATC	A26 ATC
product	8716867000016 Active power			
measurement_Unit.name	MAW MW (Mega Watt)			
auction.category	A01 Base A02 Peak A03 Off peak A04 Hourly			
curveType	A01 Sequential fixed size block	A01 Sequential fixed size block	A03 Variable sized block (when ramps excluded) A05 Non-overlapping breakpoint (when ramps included)	A01 Sequential fixed size block A05 Non-overlapping breakpoint ⁴
resolution	PT15M	PT60M PT30M PT15M	PT1M	PT60M PT30M PT15M

Table 4: Dependency matrix: ECAN Capacity document assembly model

⁴ Nordic Libra ramping information. The TSO can choose between 2 formats:

- 1) The original output uses curveType = **A01** and contains a 15 minute 'block' without ramping information.
- 2) The added format uses curveType = **A05** with 1 minute resolution and contains the ramping information for the standard product. This produces an information length of 25 (T-5 to T+20)

5.1.5 Business rules for the transfer capacity document in the Nordic countries

The following business rules apply to the Transfer capacity document in the Nordic countries:

- For the day-ahead market the Transfer capacity document is sent to NOIS before 09:00 the day before operation and should be published by the NEMOs within an hour. The message contains values for the whole coming day (24 hours).
- For the Intraday market the Transfer capacity document is sent latest 45 minutes before the operational hour, but always containing data for a whole day.
- The volume in the Transfer capacity document is always representing power (MW, without decimals).
- The Transfer capacity document will always contain two or more time series, i.e. there shall always be separate time series for each direction.
- The Direction is explicitly given by the In area and Out area. Positive values are used when the direction is from the Out area to the In area.

Rules taken from the NOIS documentation:

- The Sender Identification must be the identification of a known TSO.
- The Domain must be a known Control Area managed by the sending TSO.
- The Domain must cover either the in- or the out-Bidding Zone of each capacity time series.
- The In- and the Out area of each capacity time series must identify a known Bidding Zone.
- The Connecting line must be the identification of a known Bidding Zone.